

An energy company that puts

**SAFETY
FIRST.**

Kleenheat

THANKS

Thank you for choosing Kleenheat for your LPG supply. We consider safety our number one priority, so please make time to read through this booklet for important information on your installation.



What is LPG?

Liquefied Petroleum Gas (LPG) is a flammable fuel which in its natural state is colourless, odourless, tasteless and non-toxic. LPG describes a range of hydrocarbon gases, the most common being propane, and can be produced through extraction during natural gas production or by refining crude oil.

LPG is stored in liquid form under pressure in cylinders or tanks. When exposed to the atmosphere or if vessel pressure is reduced (for example, by burning gas via an appliance), the liquid returns to its natural vapour state.

As LPG has no smell, a distinctive “rotten cabbage” odorant is added to aid leak detection. LPG is heavier than air and will collect in low-lying areas (e.g. drains) if a leak occurs.

Site access

Our delivery vehicles need clear access to your LPG installation to deliver gas safely. Ensuring smooth access will help us maintain reliable supply. Should your business hours change, please let us know so we can update our delivery schedule accordingly. Simply email gasorderswa@kleenheat.com.au with details.

Maintaining your supply


Kleenheat schedules bulk refills automatically based on historical usage records. Keep in mind we also rely on our customers to ensure they have enough LPG to satisfy their requirements, as deliveries outside normal schedules can't be guaranteed.

We recommend regular checks of your cylinder contents gauge, especially during busy periods. You'll find the contents gauge under the cylinder lid. When we fill your cylinder, we can only fill it to a maximum of 80% to allow for LPG expansion as temperatures change.

If your tank reaches 30% or lower, simply email us at gasorderswa@kleenheat.com.au and one of our logistics coordinators will get in touch.

EQUIPMENT INFORMATION

As the owner of the storage cylinder(s) on your site, Kleenheat is responsible for its maintenance and testing. Cylinders are inspected and maintained in accordance with AS 2030.1 with installations inspected by drivers at each delivery.

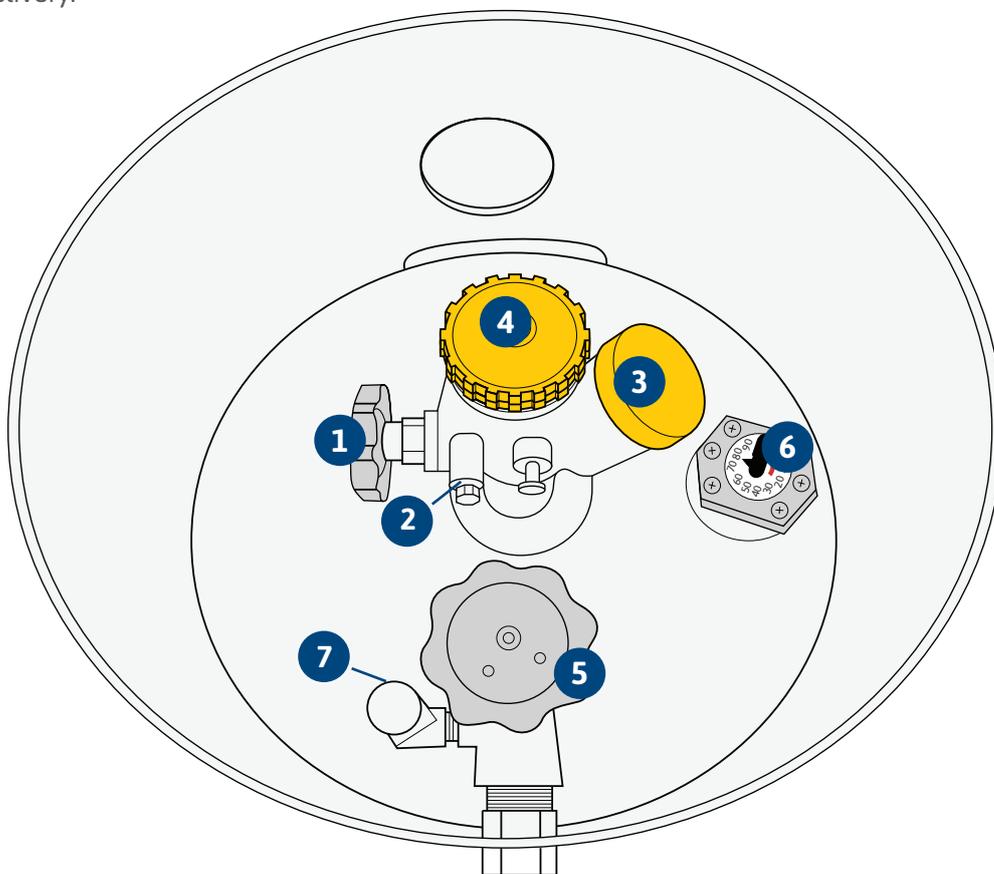

To help familiarise yourself with the installation, the following information covers basic features of your LPG equipment:

1 Vapour withdrawal valve

This valve supplies your LPG. If you ever need to isolate gas supply to your premises, this valve should be turned “off” in a clockwise direction.

2 Bleeder valve

Connected to a fixed ullage tube within the cylinder and operated by the delivery driver when transferring LPG.

3 Pressure relief valve

Safety valve protecting the cylinder against overpressure, when it vents gas until pressure is restored to safe levels.

4 Cylinder fill valve

Used by delivery drivers to transfer LPG into your cylinder.

5 Liquid withdrawal valve

Used to withdraw liquid from vessel if required, and should be capped when not in use.

6 Contents gauge

Indicates the amount of LPG inside your cylinder.

7 Hydrostatic relief valve

This safety valve protects any hoses or pipework connected to this valve against overpressure. It then resets after the pressure is restored to a safe level. *May not be positioned as depicted.*

Protective Lid

Not shown in illustration.

Your cylinder has a lockable lid for security reasons. It should always remain locked. Kleenheat provides a lock for customers, with drivers carrying a universal key for easy access during deliveries.

YOUR SAFETY

Your LPG installation must remain compliant with relevant Australian Standards and State or Territory legislation. Our Kleenheat representatives assess your site's compliance at the time of install, but on-site environments can change and cause non-compliance over time.

To help keep you and your employees safe on site, you must provide them with induction, training, and supervision regarding the safe storage and handling requirements for LPG. Refer to Dangerous Goods Safety Regulations Section 81.

Compliance and responsibilities

Kleenheat is responsible for all site LPG storage equipment. It's the responsibility of customers to maintain a compliant site, including gas pressure regulators, pipework and appliances.

Factors influencing potential installation non-compliance include:

- ✓ Electrical equipment or other sources of ignition installed after the gas installation.
- ✓ Vegetation growing too close to the LPG installation.
- ✓ Combustible materials stored too close to the installation.
- ✓ Inadequate protections from potential vehicle impact.
- ✓ Structures installed near the installation preventing good cross ventilation.

KEEPING SAFE

**and compliant is
important for us all.**



If you plan to alter the site near your LPG installation, please contact Kleenheat on 13 21 80 beforehand for advice on how to ensure your installation remains safe and compliant.

Suspected gas leaks

If you detect the distinctive “rotten cabbage” smell of LPG, take the following steps:

1. Eliminate potential ignition sources, such as cigarettes, pilot lights, sparks or mobile phones.
2. If the leak is indoors or in a confined space, open doors and windows for ventilation.
3. The location of leaks can be detected by applying soapy water to suspect joints, fittings, or equipment which results in bubbles at the point of release. This should only be done if safe to do so.
4. If safe to do so, close your gas supply by turning the supply valve clockwise.
5. Phone 1800 093 336 for specialist advice.

More information on LPG safety

Kleenheat’s Safety Data Sheets (SDS) provide additional information on the properties of hazardous chemicals and how they can affect health and safety.

Visit www.kleenheat.com.au/safety/safety-data-sheets


LPG fires

In the event of an LPG-fuelled fire, it’s important to follow these steps:

1. Initiate your Emergency Response Plan.
2. Evacuate people to a safe location, preferably upwind of the fire.
3. Contact emergency services by dialling 000.
4. Always follow the directions of emergency services.

**MAXIMISE
YOUR SAFETY.**

Minimise the risk.

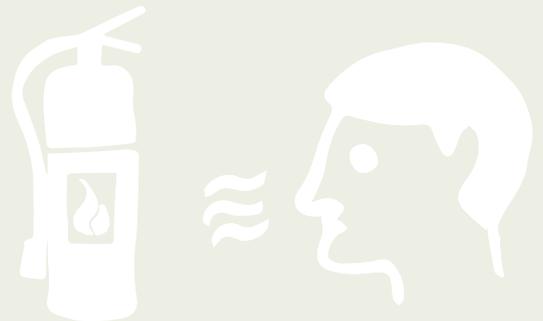

Emergency – life or property threatened: dial 000
Emergency LPG advice – non-life-threatening: 1800 093 336
Kleenheat general enquiries: 13 21 80
Kleenheat maintenance: 1300 660 459
Kleenheat bulk gas orders: gasordersWA@kleenheat.com.au

